



## Top View

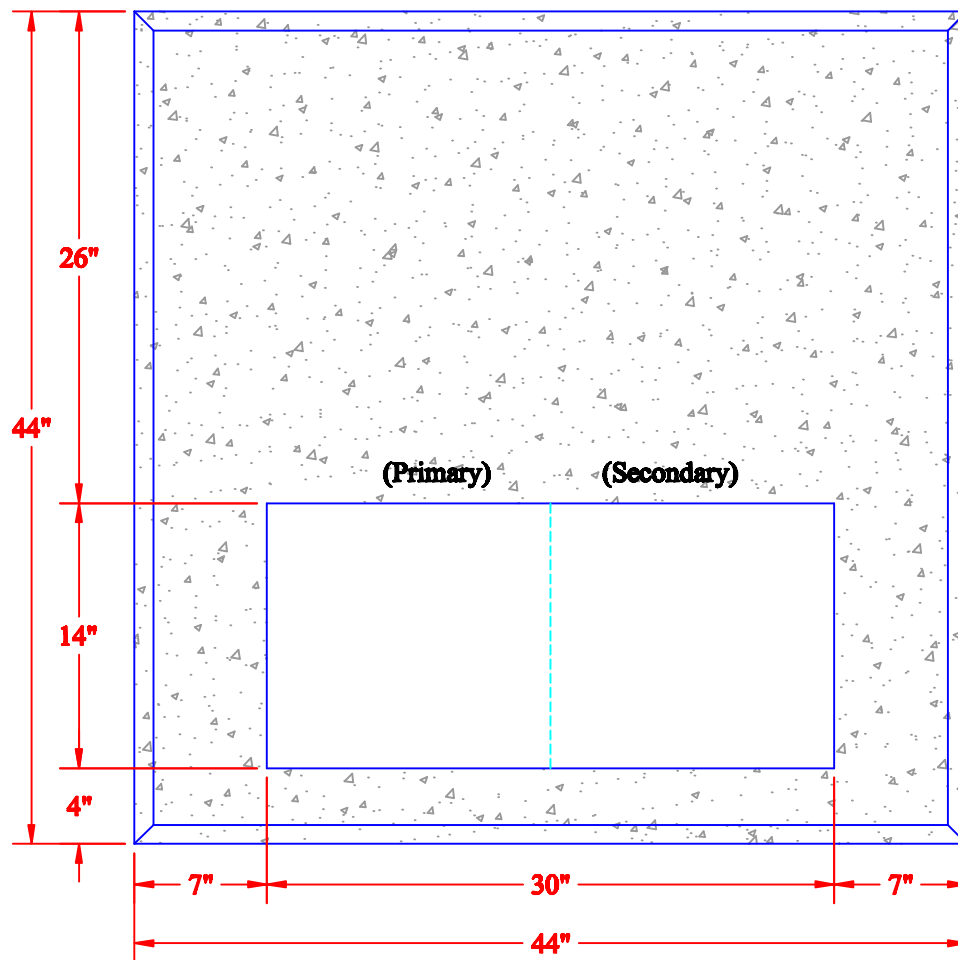

## Side View

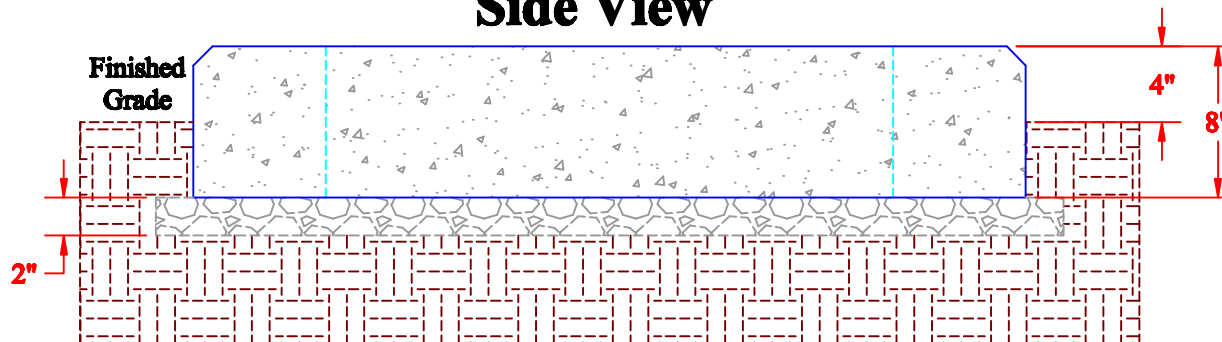

### Notes:

- 1) All edges to be beveled
- 2) Primary and secondary conduits must be grouped within their respective compartments, and extend 2" - 3" above finished concrete
- 3) Pad to be reinforced with 6" x 6" - No.10 wire mesh to within 1" of sides. Reinforcing rods to be embedded within sides adjacent to conduit openings.
- 4) Add a minimum of 2" of compacted gravel

## Concrete Transformer Pad Specification

Scale: NTS

Date: 7/21/09



SEQUACHEE VALLEY  
ELECTRIC COOPERATIVE